
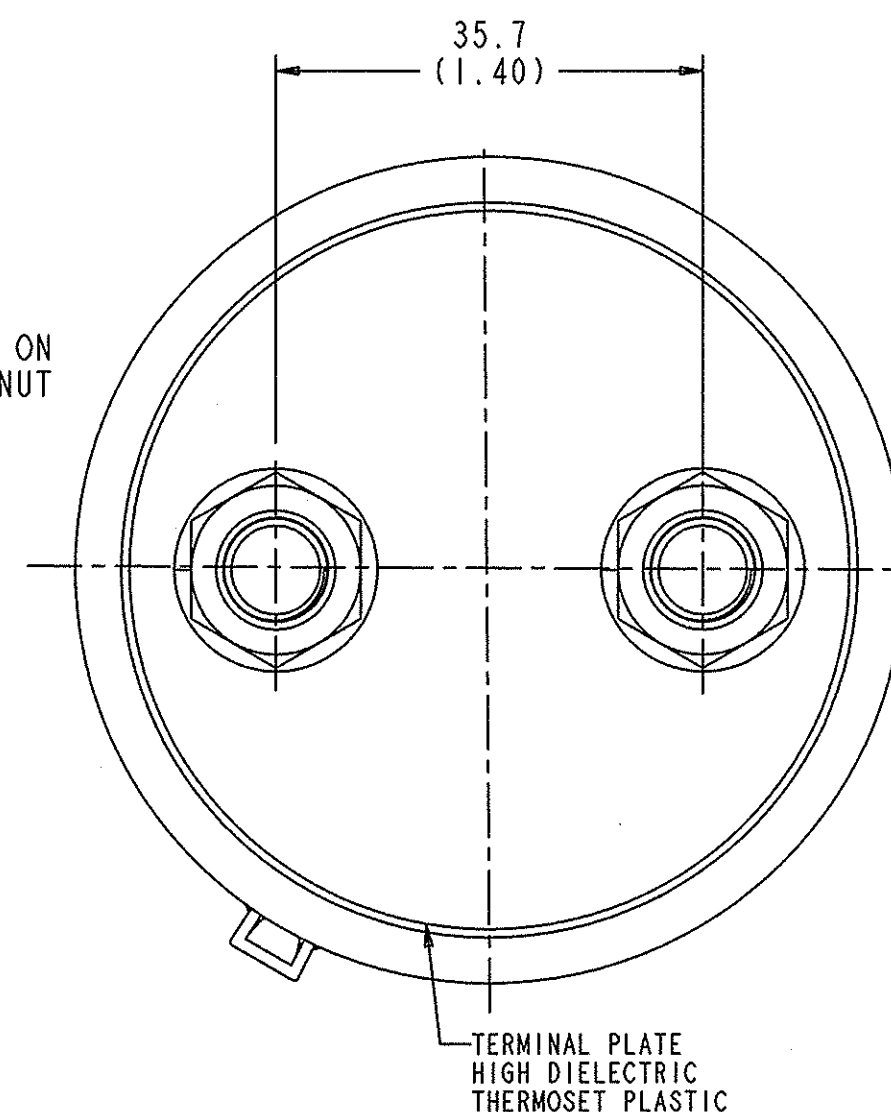
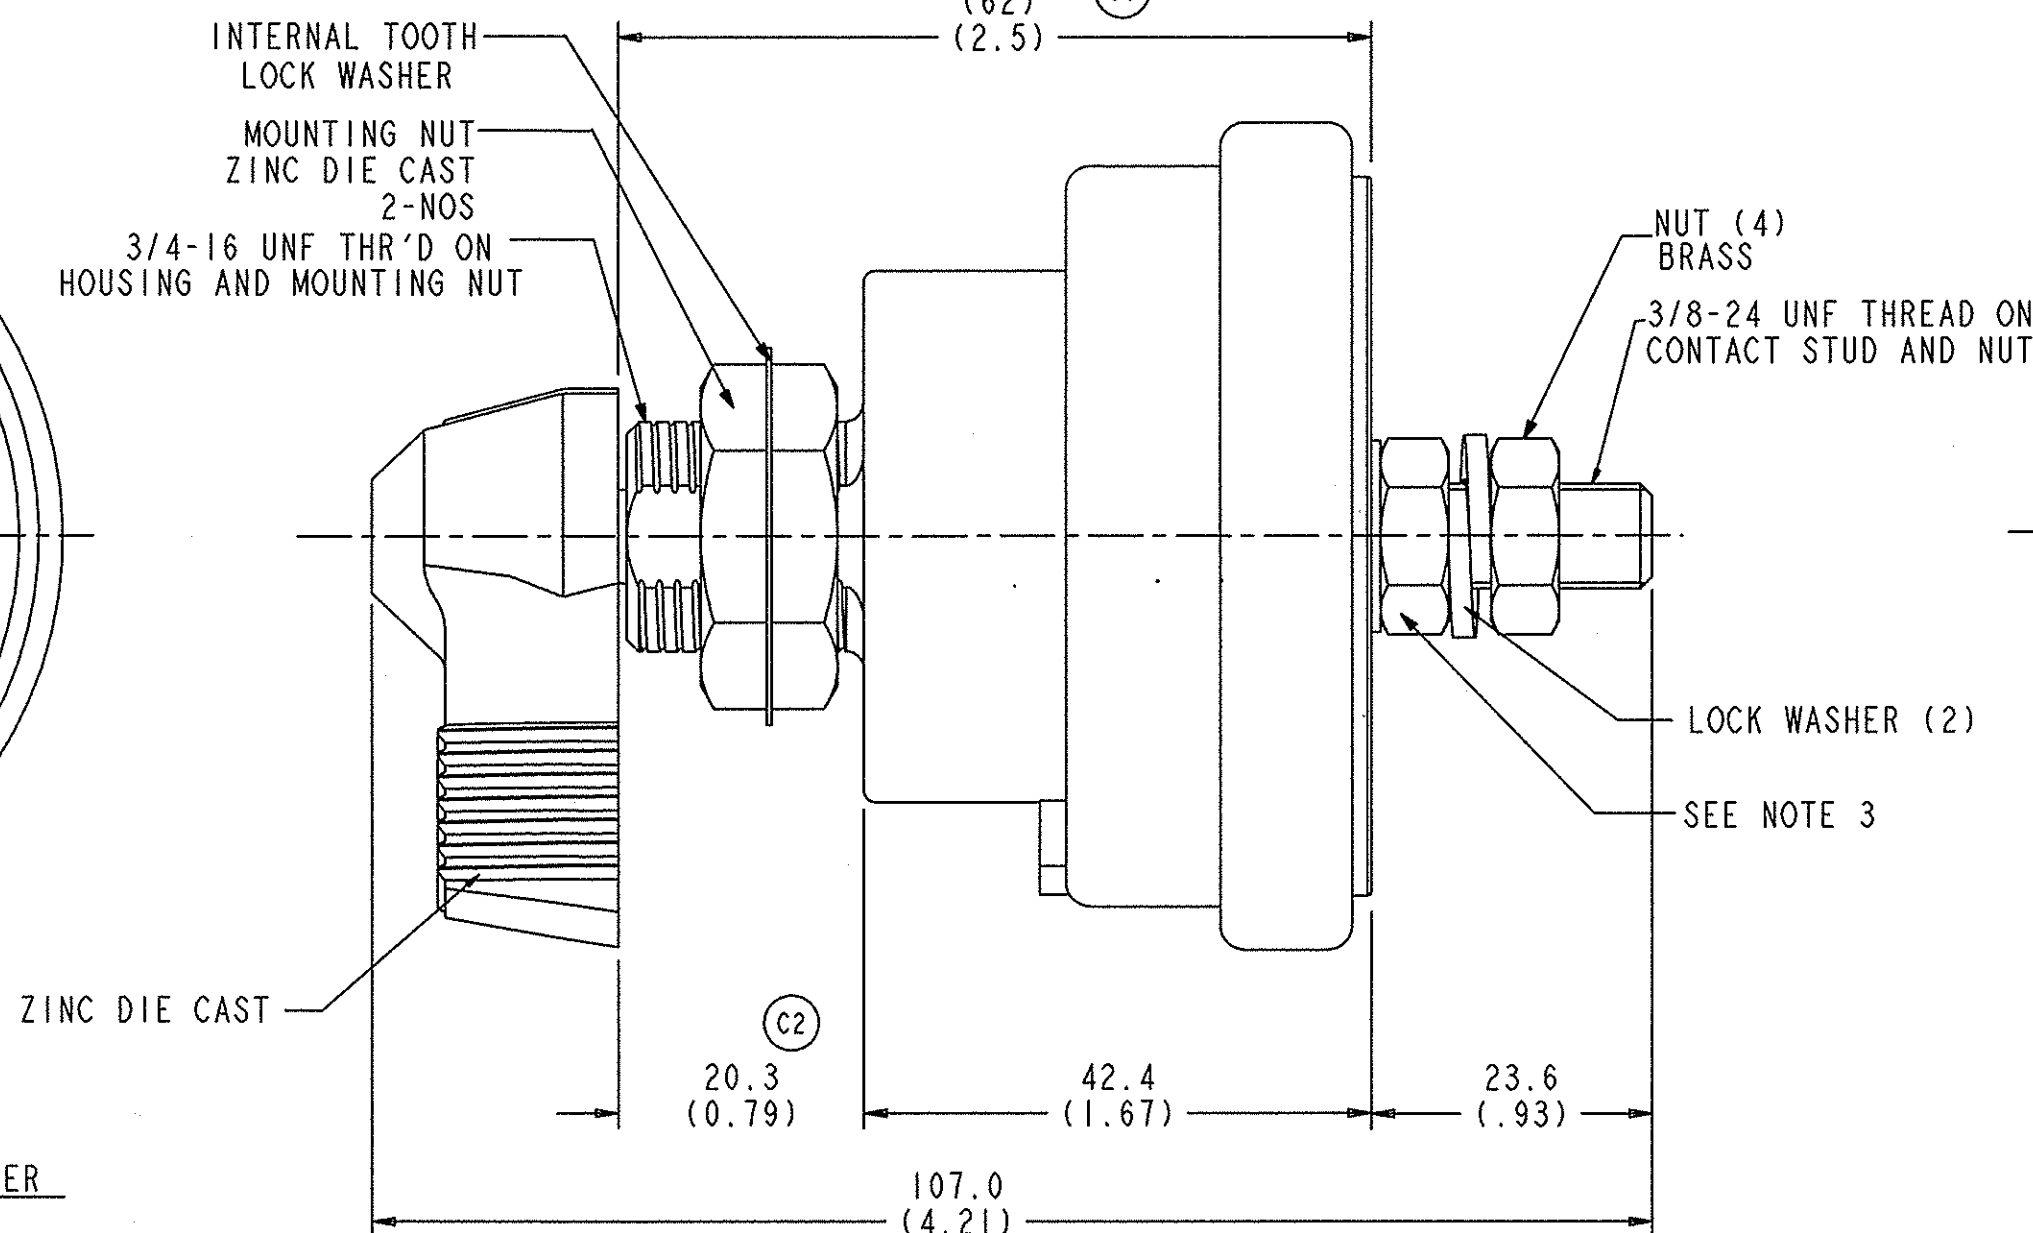


POLLAK

SWITCHING PRODUCTS DIVISION
300 DAN ROAD, CANTON MA, 02021

51-902EP

C

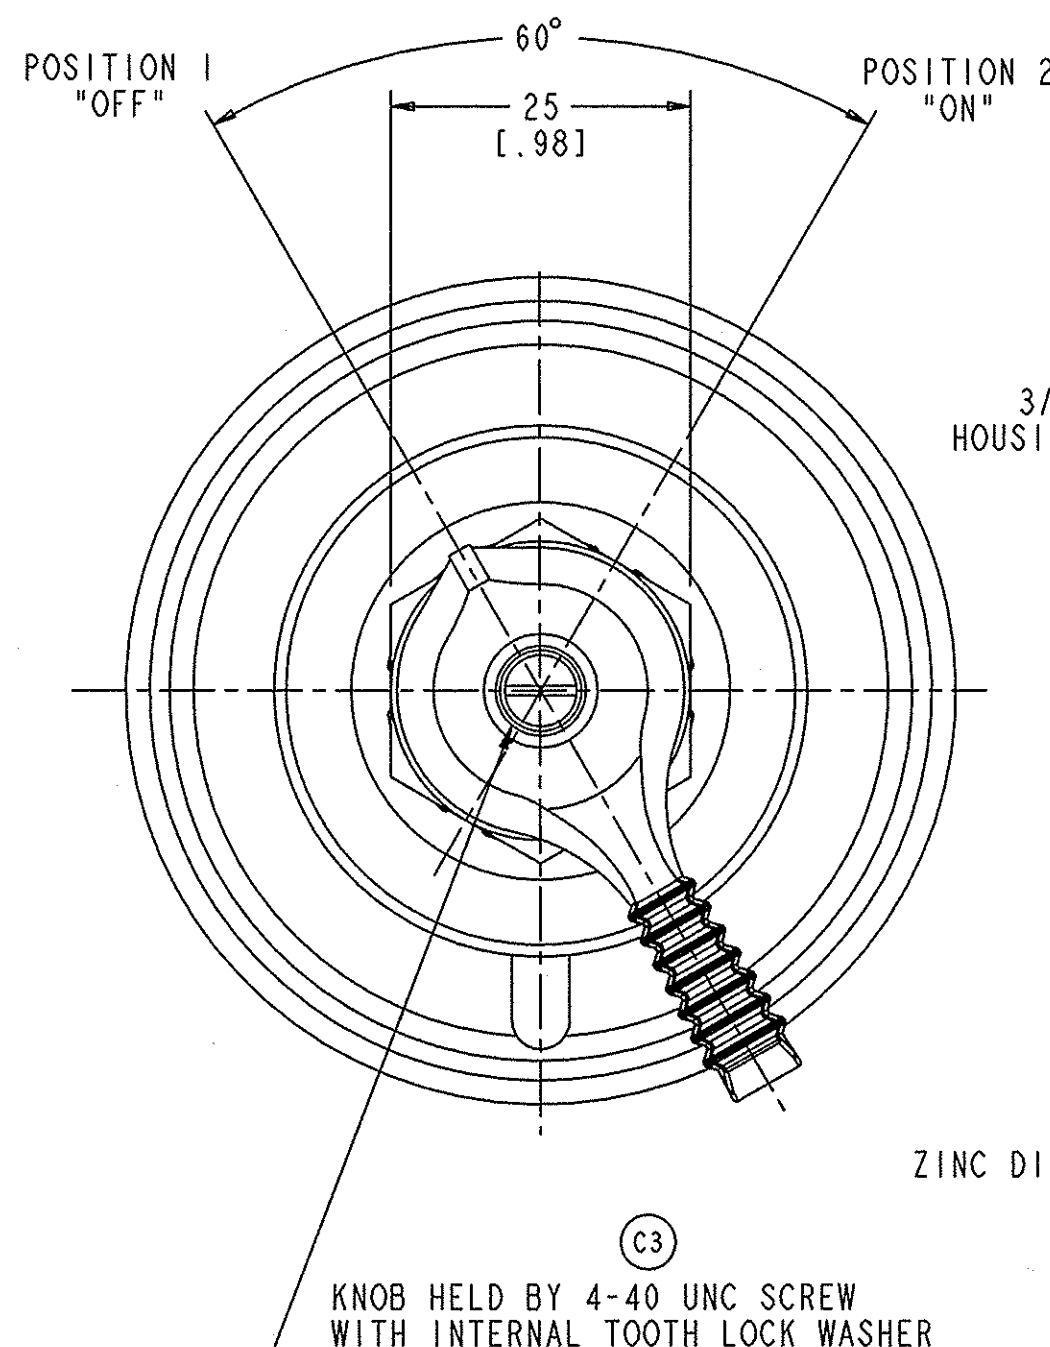

RATING :-

CONTINUOUS RATING (MAKE/BREAK)

180 AMPS - 6-36 VDC

INTERMITTENT RATING (CARRYING)

12 VOLTS D.C.

LARGE STUDS - 1000 AMPS

20 SEC. "ON" - 5 MINUTES "OFF"

SWITCH LIFE: 10,000 CYCLES MINIMUM

-40° TO 85°C

NOTE:

1. SWITCH IS WEATHER RESISTANT (NOT WATER PROOF)
2. MOUNTING NUTS NOT TO EXCEED 12 FT. LBS. TORQUE.
3. FOR INSIDE NUTS ONLY: THESE NUTS MUST REMAIN STATIONARY AND MUST NOT BE TIGHTENED OR LOOSENED
4. SECURE POWER CABLES TO MOUNTING SURFACE NO GREATER THAN 10" FROM SWITCH TO REMOVE STRAIN FROM STUDS.
5. ALL DIMENSIONS ARE REFERENCE ONLY.
6. THIS KIT INCLUDES MASTER DISCONNECT SWITCH, INSTRUCTION SHEET, AND FACE PLATE IN A BOX.

NOTE: PARTS AND COMPONENTS MUST COMPLY
WITH POLLAK QA POLICY

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION
AND SUCH INFORMATION MAY NOT BE DISCLOSED TO
OTHERS FOR ANY PURPOSE OR USED FOR MANUFACTURING
PURPOSES WITHOUT WRITTEN PERMISSION FROM POLLAK.


FORM 29, REV A

ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE
K0406	A RELEASED FOR PRODUCTION	PRS	12/23/08		
K1321	B UPDATED SEE ITEMIZED SHEET	TK	4/16/13		
K1321-1	C1, REMOVE 13-23 C2, ADD NOTE 2 ON PG 2	TK	8/14/13		

ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE

ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE	ECH	REVISIONS - AUTHORIZED - CHANGED - DATE

SCALE USED



DATE	N/A
TIME	N/A

DESIGNED BY	P. BHAT	CHANGED BY	P. R. STOCKHAUSEN	CHECKED BY	P. BHAT	APPROVED BY	C. VONNESE
FILE NAME	51-902EP-MASTER-DISCONNECT	SCALE	2:1	DATE	16-JAN-08		
CHANGED TITLE	MASTER DISCONNECT SWITCH	CHANGED NUMBER	51-902EP				

SHEET 1 OF 2